



Wastewater Service Line Inspection Form

Tapping into the mainline is NOT permitted between October 15 to April 15
Schedule an inspection 48 hours in advance. No inspections will occur on weekends or holidays.
970-349-7575

Address:

Date:

Pipe Material:

Contractor/Contact:


Service line size:

Saddle-Tap Connection: Connections must be at least ten feet from a manhole and must tap into the main with a saddle tap at either 3 o'clock or 9 o'clock position. Wye connections can be at 22° or 45° angles.

Trench Depth:
*Minimum 7' deep

Tracer Wire Y / N	Insulation Y / N
----------------------	---------------------

Type of Bedding:

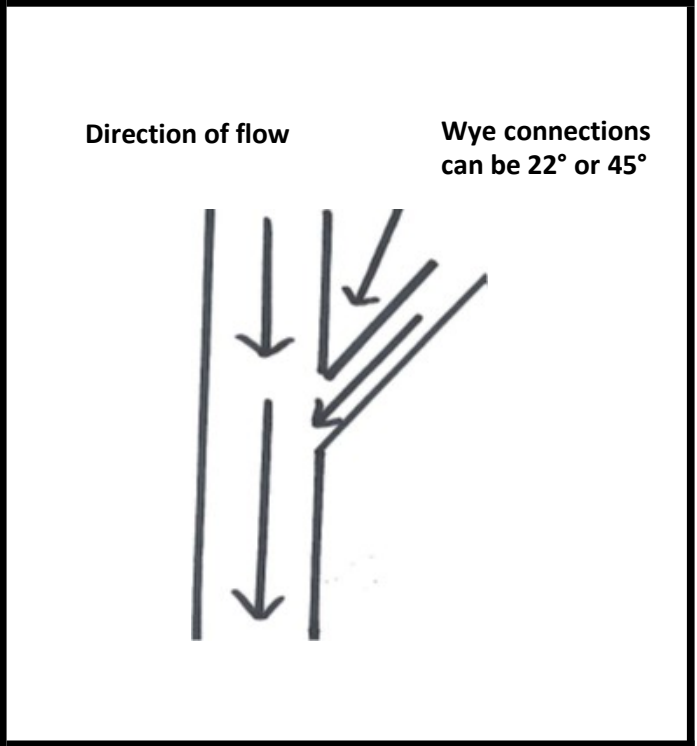

Gradient: (2%-30%)

Number of clean-outs:

Distance between clean-outs:

*First clean-out no more than 100 feet from the house and no more than 100 feet apart

MCBWSD Inspector:

Comments: